



Model S3534UR

Ultracapacitor Ride-Thru System

Customer Reference Manual

Bonitron, Inc.
Nashville, TN



An industry leader in providing solutions for AC drives.

ABOUT BONITRON

Bonitron designs and manufactures quality industrial electronics that improve the reliability of processes and variable frequency drives worldwide. With products in numerous industries, and an educated and experienced team of engineers, Bonitron has seen thousands of products engineered since 1962 and welcomes custom applications.

With engineering, production, and testing all in the same facility, Bonitron is able to ensure its products are of the utmost quality and ready to be applied to your application.


The Bonitron engineering team has the background and expertise necessary to design, develop, and manufacture the quality industrial electronic systems demanded in today's market. A strong academic background supported by continuing education is complemented by many years of hands-on field experience. A clear advantage Bonitron has over many competitors is combined on-site engineering labs and manufacturing facilities, which allows the engineering team to have immediate access to testing and manufacturing. This not only saves time during prototype development, but also is essential to providing only the highest quality products.

The sales and marketing teams work closely with engineering to provide up-to-date information and provide remarkable customer support to make sure you receive the best solution for your application. Thanks to this combination of quality products and superior customer support, Bonitron has products installed in critical applications worldwide.

AC DRIVE OPTIONS


In 1975, Bonitron began working with AC inverter drive specialists at synthetic fiber plants to develop speed control systems that could be interfaced with their plant process computers. Ever since, Bonitron has developed AC drive options that solve application issues associated with modern AC variable frequency drives and aid in reducing drive faults. Below is a sampling of Bonitron's current product offering.

WORLD CLASS PRODUCTS




Undervoltage Solutions

Uninterruptible Power for Drives
(DC Bus Ride-Thru)
Voltage Regulators
Chargers and Dischargers
Energy Storage



Overvoltage Solutions

Braking Transistors
Braking Resistors
Transistor/Resistor Combo
Line Regeneration
Dynamic Braking for Servo Drives




Common Bus Solutions

Single Phase Power Supplies
3-Phase Power Supplies
Common Bus Diodes



Portable Maintenance Solutions

Capacitor Formers
Capacitor Testers



Power Quality Solutions

12 and 18 Pulse Kits



Green Solutions

Line Regeneration

This page intentionally left blank

1. INTRODUCTION	7
1.1. Who Should Use	7
1.2. Purpose and Scope	7
1.3. Manual Version	7
Figure 1-1: S3534UR Ride-Thru System	7
1.4. Symbol Conventions Used in this Manual and on Equipment	8
2. PRODUCT DESCRIPTION	9
2.1. Related Products	9
2.1.1. Products	9
2.2. Part Number Breakdown	10
Figure 2-1: Example of Part Number Breakdown	10
Table 2-1: System Voltage Rating Codes	10
Table 2-2: Display Panel Configurations	11
Table 2-3: Cabinet Codes	11
2.3. General Specifications	11
Table 2-4: S3534UR General Specifications	11
2.4. General Precautions and Safety Warnings	12
3. INSTALLATION INSTRUCTIONS	13
3.1. Environment	13
3.2. Unpacking	13
3.3. Mounting	13
3.4. Wiring and Customer Connections	13
3.4.1. Power Wiring	13
Table 3-1: S3534UR Input Power Wiring Sizes and Fusing	15
Table 3-2: User I/O Terminal Connections for Cabinets	15
Figure 3-1: Power Connections	16
Figure 3-2: User I/O Connections Detail	16
Figure 3-3: User I/O Connections with DD4 Interface Module	17
Figure 3-4: M3534R Typical Configuration with Energy Storage	18
Figure 3-5: Ride-Thru System Configuration	19
4. OPERATION	21
4.1. Functional Description	21
4.2. Startup Procedure	21
4.2.1. Pre-Power Checks	21
4.3. Ultracapacitor Discharge Procedure	22
5. MAINTENANCE AND TROUBLESHOOTING	23
5.1. Field Test Procedure	23
5.2. Troubleshooting	24
Table 5-1: Troubleshooting Guide	24
5.3. Technical Help – Before You Call	24
6. ENGINEERING DATA	25
6.1. Ratings	25
6.2. Watt Loss (Inactive Power Consumption)	25
6.3. Rating Charts	25
Table 6-1: Model Specifications	25
Table 6-2: Voltage Specifications Table	25
Table 6-3: M3534 kW Ratings	26
Table 6-4: Factory Setpoints for DC Bus Threshold and Test Boost Voltages	26
6.4. Dimensions and Mechanical Drawings	27
Figure 6-1: E70 Cabinet Dimensional Outline	27
Figure 6-2: E71 Cabinet Dimensional Outline	28

Figure 6-3: D80 Cabinet Dimensional Outline29

1. INTRODUCTION

1.1. WHO SHOULD USE

This manual is intended for use by anyone who is responsible for integrating, installing, maintaining, troubleshooting, or using this equipment with any AC drive system. Please keep this manual for future reference.

1.2. PURPOSE AND SCOPE

This manual is a user's guide for the Model S3534UR Ultracapacitor Ride-Thru systems. It will provide the user with the necessary information to successfully install, integrate, and use these in a variable frequency AC drive system.

In the event of any conflict between this document and any publication and/or documentation related to the AC drive system, the latter shall have precedence.

1.3. MANUAL VERSION

The updated release of the S3534UR manual is Rev 02a.








Updated table 3-2, figure 3-2 and figure 3-3 in Rev 02b.

Updated figure 3-5 in Rev 02c.

Figure 1-1: S3534UR Ride-Thru System



1.4. SYMBOL CONVENTIONS USED IN THIS MANUAL AND ON EQUIPMENT

	Earth Ground or Protective Earth
	AC Voltage
	DC Voltage
	DANGER: Electrical hazard - Identifies a statement that indicates a shock or electrocution hazard that must be avoided.
	DANGER: Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss.
	CAUTION: Identifies information about practices or circumstances that can lead to property damage, or economic loss. Attentions help you identify a potential hazard, avoid a hazard, and recognize the consequences.
	CAUTION: Heat or burn hazard - Identifies a statement regarding heat production or a burn hazard that should be avoided.

2. PRODUCT DESCRIPTION

Bonitron S3534UR series of DC bus ride-thru systems provide protection from line voltage outage for variable frequency drives (VFDs) that use a fixed rectifier and DC bus, providing power for outage times up to 2 seconds.

Industries with continuous processes can suffer huge losses from equipment downtime, loss of production, or damaged product when VFDs trip on undervoltage conditions. While many drives claim to have ride through capability such as auto restart or kinetic buffering, none are able to control the motor during a complete loss of power. Typical UPS solutions are designed to increase drive availability, but are connected in series which decreases overall drive system reliability. All Bonitron ride-thru products connect in parallel with the drive, thus increasing system availability and reliability.

Bonitron S3534UR systems provide sufficient ride through capability to handle these outages by storing energy in ultracapacitor banks and releasing it back into the drives' DC bus when needed. This allows the drive to "Ride-Thru" these events while maintaining motor speed and torque without experiencing drive shutdown.

A complete S3534UR ultracapacitor backup system includes, isolation transformer, charger, ultracapacitor, discharger, discharge resistor, and booster module.

ADVANTAGES

- Reliability
- Parallel connection to AC system
- Works with almost any fixed bus, variable frequency, PWM drive
- Only 2-3 parallel connections
- Can use existing AC feed wiring and breakers
- Instant response
- Bumpless transfer
- Easy commissioning

2.1. RELATED PRODUCTS

2.1.1. PRODUCTS

M3460 SERIES RIDE-THRU MODULES

Voltage regulators used for sag or outage protection of higher power systems.

M3528 BATTERY AND ULTRACAPACITOR CHARGERS

Chargers for high voltage storage strings.

S3534SR SERIES SAG RIDE-THRU SYSTEMS

An enclosed system for 50%-line sag for 2 seconds or a single phase full outage for up to 2 seconds

S3534BR SERIES BATTERY RIDE-THRU SYSTEMS


An enclosed system for full outage up to 60 seconds.

KIT 3628T AND M3628R ULTRACAPACITOR DISCHARGER AND RESISTOR

The KIT 3628T and M3628R discharger and resistor safely discharges the ultracapacitors to a safe voltage level quickly.

2.2. PART NUMBER BREAKDOWN

Figure 2-1: Example of Part Number Breakdown

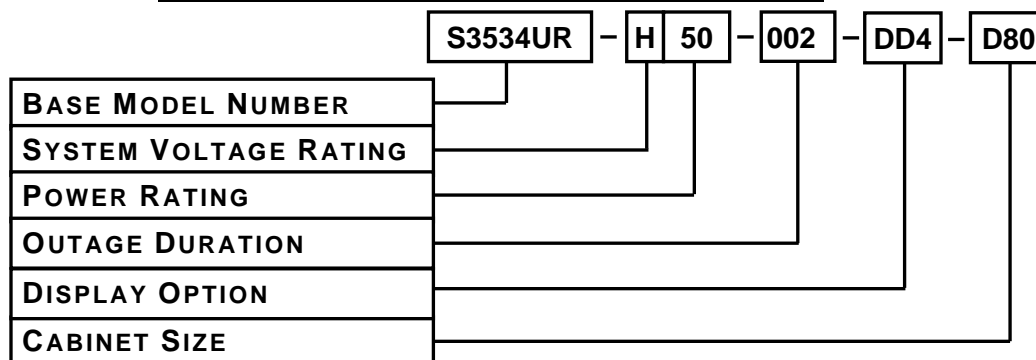

BASE MODEL NUMBER

The base model number for all enclosed ultracapacitor ride-thru systems is S3534UR.

SYSTEM VOLTAGE RATING

The system voltage rating indicates the nominal AC / DC voltage levels of the AC drive system the ride-thru is intended to support. A letter indicates the system voltage.

Table 2-1: System Voltage Rating Codes

RATING CODE	VOLTAGES (NOMINAL AC LINE / DC BUS)
L	230VAC / 320VDC
E	380 - 415VAC / 540 - 585VDC
H	460VAC / 640VDC

POWER RATING (KW)

The power rating indicates the maximum power in kilowatts that can safely be handled by the S3534UR and is represented by a 3-digit value based on the nominal DC system voltage rating and the maximum output current rating of the S3534UR. For instance, the code **50** indicates a 50kW S3534UR.

OUTAGE DURATION

The outage duration indicates the amount of time (in seconds) the M3534 module is able to hold the DC bus at the threshold level while loaded to the rated current. This duration is directly represented by a 3-digit value. For example, 002 represents 2 seconds of outage duration.

DISPLAY OPTION

The display option indicates which display is mounted on the front of the enclosure. The displays show the S3534UR operating status and also permit a system test to be performed. The DD5 digital display has many more features than the DP10 display, including outage and fault logging. Please refer to the KIT 3660DD5 manual for a full description of features.

Table 2-2: Display Panel Configurations

DISPLAY MODEL	LOCAL INDICATORS	VOLTMETER	AMMETER	TOTAL COUNTER	RESETTABLE COUNTER	ACTIVITY LOGGING	LOCAL TEST INITIATION
DD5	✓	✓	✓	✓	✓	✓	✓
DP10	✓				✓		✓

CABINET SIZE

The Model S3534UR ultracapacitor system is available in various cabinet sizes. Size is dependent on the boost module's kW rating. The cabinet size is indicated by a code as shown in Table 2-3. See Section 6.4 for complete dimensional outline.

Table 2-3: Cabinet Codes

CABINET CODE	DESCRIPTION
E70	48" H x 36" W x 12" D, UL Type-12 wall mount enclosure
E71	60" H x 36" W x 12" D, UL Type-12 wall mount enclosure
D80	71" H x 40" W x 20" D, UL Type-12 floor mount enclosure

2.3. GENERAL SPECIFICATIONS

Table 2-4: S3534UR General Specifications

PARAMETER	SPECIFICATION
System AC Voltage	230 – 480 VAC
Output DC Voltage Range	320 – 650 VDC
Threshold Voltage Level	285 – 585 VDC
DC Bus Current Rating (Max)	20 – 85 ADC
Power Rating (Range)	06 – 50 kW
Outage Duration	0.5 – 2.0 seconds
Operating temperature	0 - 40°C
Duty Cycle (Full Load)	1%
Storage Temperature	-20 - 65°C
Status Output Signals	Opto FET 350V, 120mA
Humidity	Below 90% non-condensing
Atmosphere	Free of corrosive gas and conductive dust
Logic I/O	Inputs 24 VDC, 15 mA • Enable / Disable input

2.4. GENERAL PRECAUTIONS AND SAFETY WARNINGS



DANGER!

- **HIGH VOLTAGES MAY BE PRESENT!**
- **NEVER ATTEMPT TO OPERATE THIS PRODUCT WITH THE ENCLOSURE COVER REMOVED!**
- **NEVER ATTEMPT TO SERVICE THIS PRODUCT WITHOUT FIRST DISCONNECTING POWER TO AND FROM THE UNIT.**
- **ALWAYS ALLOW ADEQUATE TIME FOR RESIDUAL VOLTAGES TO DRAIN BEFORE REMOVING THE ENCLOSURE COVER.**
- **FAILURE TO HEED THESE WARNINGS MAY RESULT IN SERIOUS BODILY INJURY OR DEATH!**



CAUTION!

- **CERTAIN COMPONENTS WITHIN THIS PRODUCT MAY GENERATE HIGH AMBIENT TEMPERATURES DURING OPERATION.**
- **ALWAYS ALLOW AMPLE TIME FOR THE UNIT TO COOL BEFORE ATTEMPTING SERVICE ON THIS PRODUCT.**
- **BEFORE ATTEMPTING INSTALLATION OR REMOVAL OF THIS PRODUCT, BE SURE TO REVIEW ALL DRIVE AND/OR RESISTIVE LOAD DOCUMENTATION FOR PERTINENT SAFETY PRECAUTIONS.**
- **INSTALLATION AND/OR REMOVAL OF THIS PRODUCT SHOULD ONLY BE ACCOMPLISHED BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE OR EQUIVALENT REGULATIONS.**
- **THIS PRODUCT DOES NOT PROVIDE MOTOR OVERLOAD PROTECTION.**

ANY QUESTIONS AS TO APPLICATION, INSTALLATION, OR SERVICE SAFETY SHOULD BE DIRECTED TO THE EQUIPMENT SUPPLIER.

3. INSTALLATION INSTRUCTIONS



Installation and/or removal of this product should only be performed by a qualified electrician in accordance with National Electrical Code or local codes and regulations.

Proper installation of the S3534UR ultracapacitor ride-thru should be accomplished following the steps outlined below. Be sure to refer to the AC drive instruction manual as these steps are performed. Please direct all installation inquiries that may arise during the installation and startup of this product to the equipment supplier or system integrator.

3.1. ENVIRONMENT

The maximum operating temperature of the ride-thru system should not exceed 40°C.

3.2. UNPACKING

Upon receipt of this product, please verify that the product received matches the product that was ordered and that there is no obvious physical damage to the unit. If the wrong product was received or the product is damaged in any way, please contact the supplier from which the product was purchased.

3.3. MOUNTING

1. Move the cabinet to the desired installation site.
2. Remove the hardware securing the cabinet to its pallet.
3. Using a crane or hoist connected to the cabinet's lifting eyes, remove the cabinet from the pallet, and set it in the desired location.
 - Secure the S3534UR cabinet in place. Cabinets may be anchored to the floor as necessary, E Series Cabinets can be bolted to the wall using existing mounting feet.
 - Mount the Ultracapacitor Discharge Resistor within 20 feet of the capacitor bank.

3.4. WIRING AND CUSTOMER CONNECTIONS

Review this entire Section before attempting to wire the S3534UR.

3.4.1. POWER WIRING



***THE M3534 CAN HAVE MULTIPLE POWER SOURCES, INCLUDING THE MAIN AC INPUT, ENERGY STORAGE SYSTEMS AND THE DC CONNECTION TO THE VFD.
ENSURE THAT ALL SOURCES ARE DISCONNECTED AND LOCKED OUT BEFORE ATTEMPTING SERVICE OR INSTALLATION.
FAILURE TO HEED THESE WARNINGS MAY RESULT IN SERIOUS INJURY OR DEATH!***

This section provides information pertaining to the field wiring connections of the S3534UR ride-thru cabinet system. Actual connection points and terminal numbers of the AC drive system will be found in the documentation provided with that drive system.

Be sure to review all pertinent AC drive system documentation before proceeding.

3.4.1.1. POWER CONNECTIONS

AC LINE (L1, L2, L3) CONNECTIONS

During operation, the load on the AC line is used for charging and maintaining the ultracapacitor storage modules.

See Section 6.3 for the full load and standby AC ratings.

DC BUS (+ -) CONNECTIONS

The S3534UR must have a DC bus connection directly to the DC bus filter capacitors within the drives. Connections cannot be made through the braking terminals or with precharge resistors or DC link chokes between the output of the S3534UR and the DC bus capacitors in the drive. Consult the manufacturers' documentation or contact Bonitron for further assistance.

Make sure the polarity is correct for these connections, as failure to do so can cause severe damage to the system.

GROUNDING REQUIREMENTS

Cabinet should be earth grounded to the stud in upper right corner of the backplate. See Table 3-1 for wire size.

Ultracapacitor Bank Wiring

The following data is supplied for assistance in selecting the appropriate field wiring sizes and power source fuse ratings for the model S3534UR cabinet ride-thru systems.

- Wire size must be coordinated with circuit protection devices and IR drop of wire. It is NOT necessary to size the wire for continuous duty. The maximum allowed duty cycle for the S3534UR ride-thru is two, 2 second cycles per minute, per hour.
- Steady state class J time delay or equivalent power source fusing should be used to support the requirement for 2-second 2x surge capability. The recommended minimum current rating for the power source fusing is listed in Table 3-1 below, based on the DC bus current rating of the ride-thru module.
- The field wiring sizes listed in Table 3-1 below assume a 10 V drop for wire lengths of 100 feet and are compatible with the recommended steady state power source fusing listed. The wire gauge selected for field wiring to the ride-thru should be equal to or greater than that listed in Table 3-1. The maximum wire gauge that can physically be accepted by the disconnects for cabinet mounted systems is 4 AWG.

Table 3-1: S3534UR Input Power Wiring Sizes and Fusing

SYSTEM kW	RIDE-THRU DC BUS CURRENT RATING	AC LINE FUSING (CLASS J TIME DELAY)	DC BUS FUSING (CLASS J TIME DELAY)	RECOMMENDED FIELD WIRING SIZES
6 – 12 kW	20 A	30 A, 600 V	20 A, 700V	12 AWG
2 – 24 kW	40 A	60A, 600 V	40 A, 700 V	10 AWG
25 – 50 kW	85 A	100 A, 600 V	80 A, 700 V	6 AWG

Use copper wiring rated for 75°C for all connections.

3.4.1.2. CONTROL INTERFACE AND I/O WIRING

The control interface and I/O wiring are from the M3534 ride-thru module. Please see the M3534 manual for further information on these outputs.

See Figure 3-1 for terminal locations.

Table 3-2: User I/O Terminal Connections for Cabinets

TERMINAL	FUNCTION
TB – 1	Courtesy + 24V
TB – 2	Charger ENABLE
TB – 3	Ride-Thru ENABLE
TB – 4	Ride-Thru TEST
TB – 5	Input COM
TB – 6	Courtesy COM
TB – 7	Fault 1
TB – 8	Fault 2
TB – 9	Ride-Thru Active (RTA)
TB – 10	Output COM

Figure 3-1: Power Connections

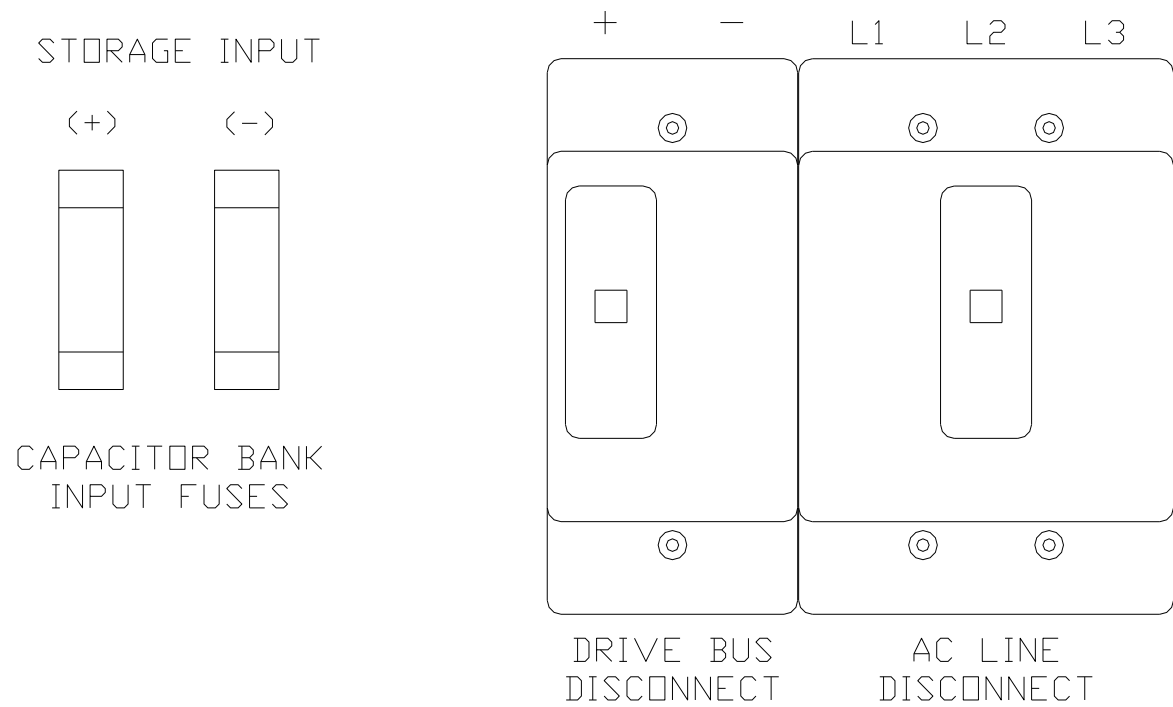


Figure 3-2: User I/O Connections Detail

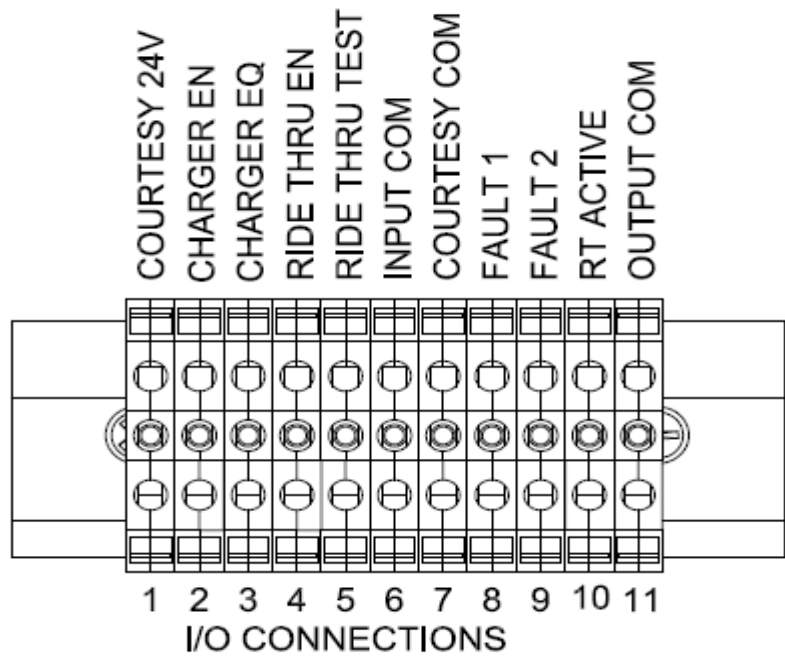


Figure 3-3: User I/O Connections with DD5 Interface Module

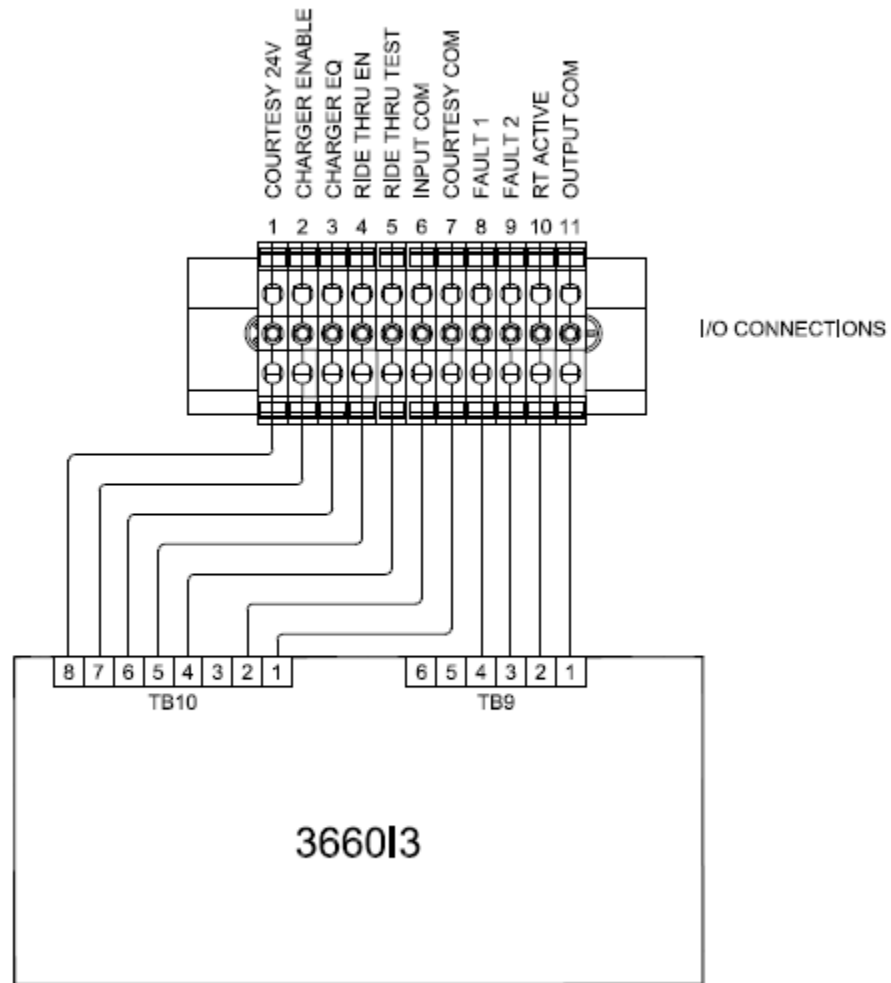


Figure 3-4: M3534R Typical Configuration with Energy Storage and M3528 charger


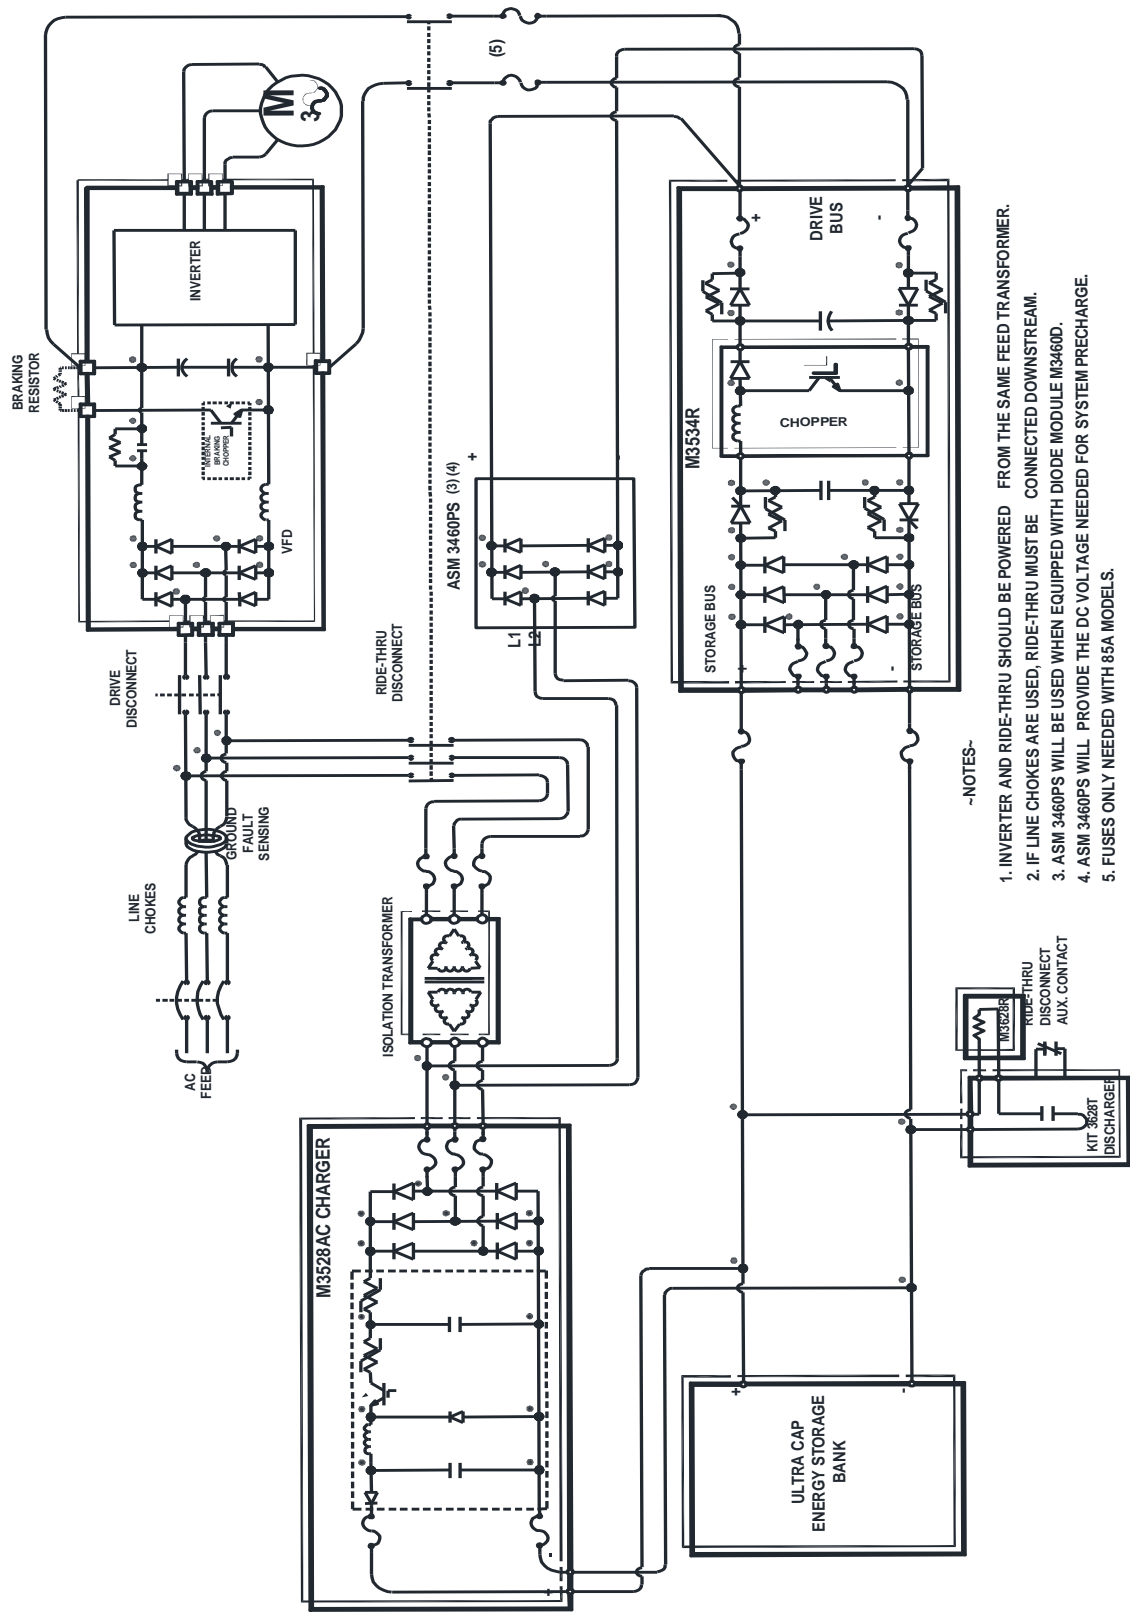


Figure 3-5: M3534R Typical Configuration with Energy Storage and M5628 Charger

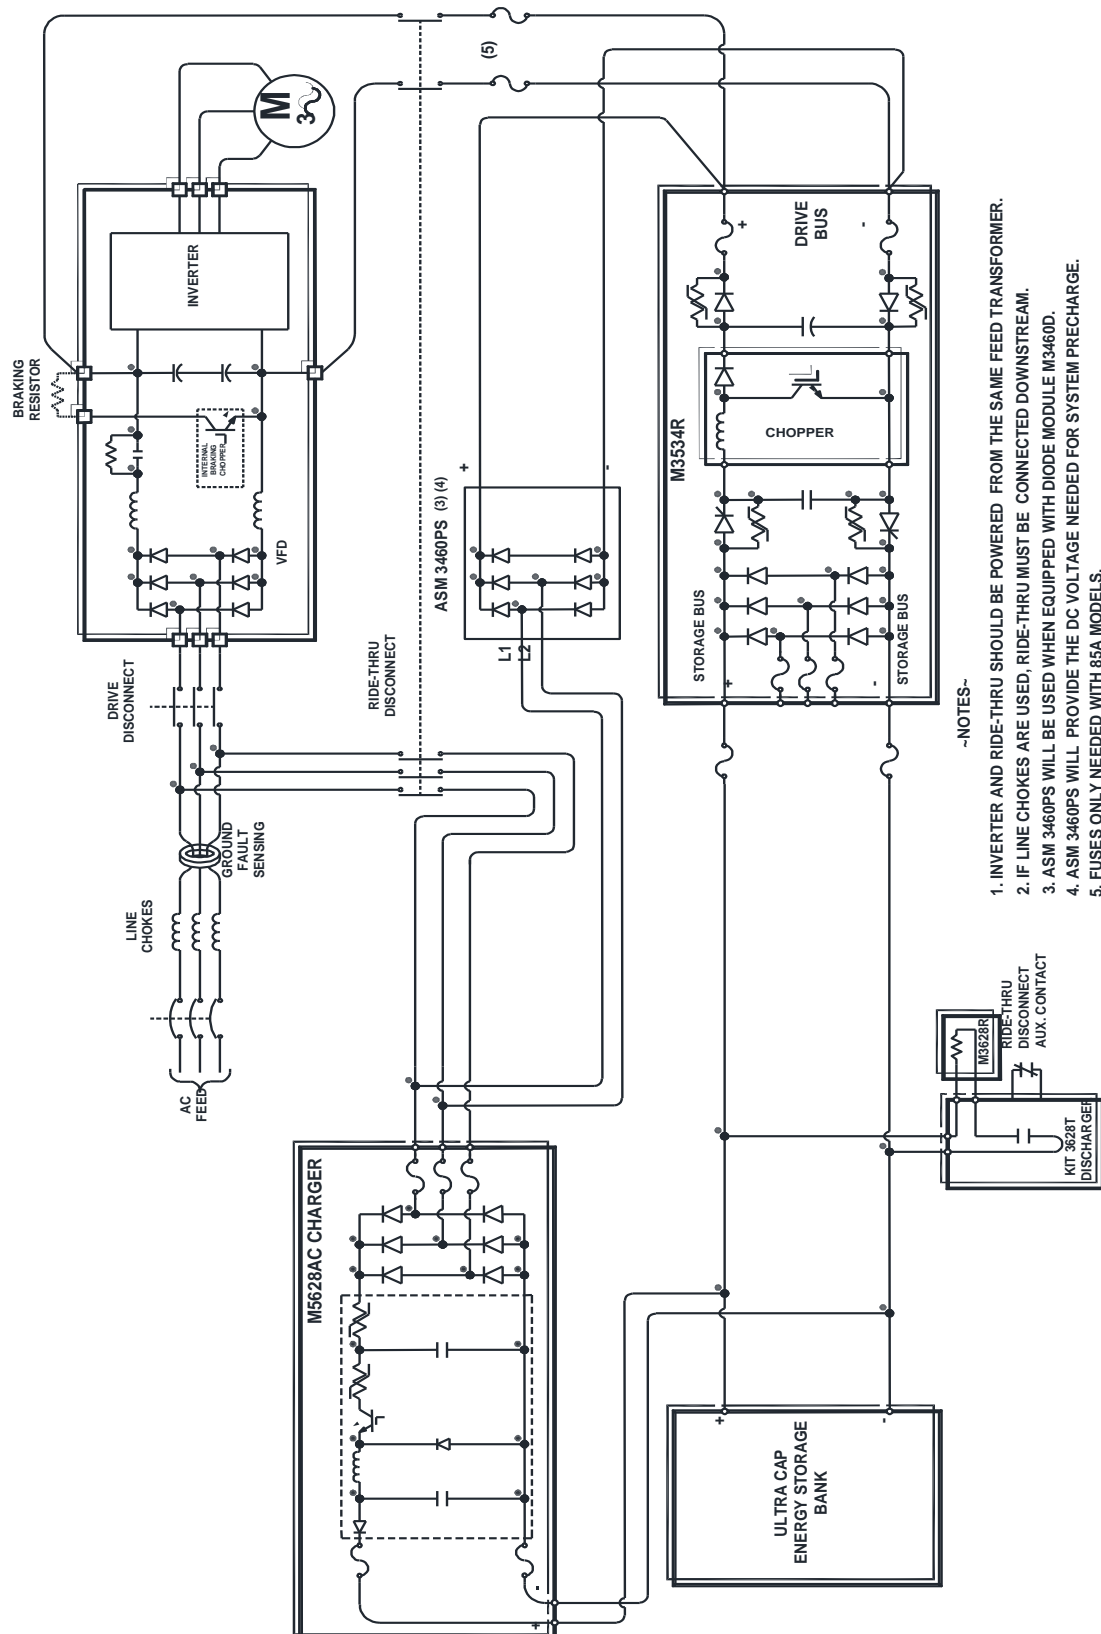

This page intentionally left blank

4. OPERATION

4.1. FUNCTIONAL DESCRIPTION

The S3534UR ride-thru system monitors the DC bus of the attached variable frequency drive (VFD) and provides power in a voltage controlled, current limited supply directly to the filter capacitor section of the drive above the inverter stage. During a power quality event, such as a sag or power outage, the internal DC bus of the VFD drops. When this level meets the DC bus threshold voltage of the S3534UR, power is delivered through blocking diodes to hold up the voltage in the VFD bus.

Energy is stored in an ultracapacitor bank and the boost module regulates and boosts the output voltage to the drive at a constant voltage.

The ultracapacitor modules are wired in series configuration to get voltages up to a usable level and in parallel for more energy storage.

In standby mode, or when the incoming AC power is normal, the system recharges the ultracapacitor bank and holds the energy storage at a constant level. Once the capacitor bank is charged, the standby energy consumption is minimal.

4.2. STARTUP PROCEDURE

4.2.1. PRE-POWER CHECKS

1. Ensure the Bonitron ride-thru has been properly installed as per the instructions in Section 3 of this manual.
2. Check the polarity of the DC bus connection to the VFD at the disconnect. It is critical that this is correct.
3. The ride-thru DC bus threshold must be coordinated with the under voltage trip setting of the VFD. If the threshold is too close to the nominal bus, the ride-thru may supply power to the drive continuously, and overheat. If the threshold is too close to the under voltage trip level of the VFD, the system may not "Ride-Thru", and under voltage trips will still occur. Most VFDs have an Undervoltage trip point of -15% of the nominal voltage level.
Bonitron sets all ride-thru threshold levels at -10% of the nominal DC bus voltage level. For example, all 460 VAC systems will hold the DC bus level at 585 VDC.
4. Refer to the drive manual for details on adjustment of the under voltage trip setting, it is typically 80-85% of the full DC bus voltage.
5. Power up the attached drive system. This should be done according to the procedure for the VFD. Ensure that the associated VFD is working properly prior to connecting to the ride-thru system.

4.3. ULTRACAPACITOR DISCHARGE PROCEDURE

1. Remove the enable signal to the M3534 booster module.
2. Turn off the AC input using the main disconnects. This will disconnect incoming AC power and the output DC power to the VFD.
3. Apply enable signal or turn discharge switch to the DISCHARGE position.
 - Capacitor voltage should begin to decrease.
 - Once capacitor voltage has dropped to 5V or less, a shorting strap or low ohm resistor (below 100Ω) may be connected across the capacitor terminals to prevent a residual charge from building up on the capacitor bank.

5. MAINTENANCE AND TROUBLESHOOTING

Repairs or modifications to this equipment are to be performed by Bonitron approved personnel only. Any repair or modification to this equipment by personnel not approved by Bonitron will void any warranty remaining on this unit.

5.1. FIELD TEST PROCEDURE

The Bonitron S3534UR ride-thru system is designed to be low maintenance. However, the connected energy storage bank will degrade over time, and should be periodically checked. Bonitron recommends a yearly test of the system in order to ensure the electronics package is operating properly, and the storage bank has proper capacity. The following steps can be taken to ensure reliability that the system is still able to ride-thru an outage event.

Each Bonitron ride-thru should be tested under load during initial start up to verify the functionality of the test circuit and that the test does not negatively affect the process. However, Bonitron recommends that if the process is critical, the test cycle be initiated only during a scheduled shutdown.

1. Ensure the S3534UR has been properly installed and is disabled.
2. Ensure the AC line input and drive bus are all installed properly to the cabinet disconnect. Ensure the ultracapacitor bank, charger, and the discharger are installed properly.
3. Turn on the cabinet disconnect and observe the display status. The status should display Ride-Thru Ready. If there are faults on the system, turn off power and check the KIT 3660DD4 and the M3534 manuals for further troubleshooting details.
4. Enable the S3534UR with either the Enable input or the digital display.
5. Load the VFD as much as is practical for testing.
6. Initiate the test mode with the display panel to confirm that the booster is working properly.

The DC bus should rise for about 100 VDC above the normal DC bus level.

7. Verify energy storage bank charge by removing AC power to the drive simulating an outage event.
 - The DC bus voltage should drop to the threshold voltage level.
 - Ride-Thru Active indicator turns ON.
 - DC bus voltage should hold at the threshold voltage level.
 - The drive should continue to run normally.
 - Motor speed should remain constant.
 - The system should only be allowed to run for a maximum of 2 seconds.
 - Re-apply the AC power to the inverter input.

This completes the maintenance procedure and the S3534UR and drive system should now be ready to be put into service.

5.2. TROUBLESHOOTING

Table 5-1: Troubleshooting Guide

SYMPTOM	ACTION
No LEDs	▪ Check incoming power.
No RTR Output	▪ Check Enable input.
Test Mode Does Not Raise Output Voltage	▪ Check Enable input. ▪ Check Test input ▪ Check incoming and outgoing fuses ▪ Check normal DC bus voltage. If the DC bus is normally too high, the DC bus test setpoint may not raise the output voltage.
RTA Always On	▪ Check DC bus threshold voltage setting.
Ride-Thru Active Output Never Comes On or Attached Drive Trips On Outages	▪ Check Enable input ▪ Check DC link to attached drive. ▪ Initiate Test Mode. If the test does not raise the DC bus and / or the Ride-Thru Active output does not activate, there could be internal damage ▪ Check power quality data to confirm sag events should have caused activity to occur
Overtemp	▪ Check for constant current on the negative and positive DC bus links to the drive. Circulating currents may be overheating the unit in standby. ▪ Check activity record – too much activity causes overtemp
Voltage Fluctuates During Test Mode	▪ Check DC bus threshold voltage setting and test boost level. Overvoltage shutdown can occur if settings are too high, causing an oscillation effect. Lower threshold level and retry.
Stays in Test Mode	▪ Check to make sure test input is properly configured and not active.
Precharge Overheated	▪ Not enough time between power up / power down during testing. Pre-charge can only be done 3 consecutive times before overheating can occur ▪ Check DC bus ripple voltage. Too much ripple can cause the precharge circuit to overheat.



CAUTION!

REPAIRS OR MODIFICATIONS TO THIS EQUIPMENT ARE TO BE PERFORMED BY BONITRON APPROVED PERSONNEL ONLY. ANY REPAIR OR MODIFICATION TO THIS EQUIPMENT BY PERSONNEL NOT APPROVED BY BONITRON WILL VOID ANY WARRANTY REMAINING.

5.3. TECHNICAL HELP – BEFORE YOU CALL

If possible, please have the following information when calling for technical help:

- Exact model number of affected units
- Serial number of unit
- Name and model number of attached drives
- Name of original equipment supplier
- Brief description of the application
- The AC line to line voltage on all 3 phases
- The storage bank voltage
- The DC bus voltage
- KVA rating of power source
- Source configuration Wye/Delta and grounding

This information will help us support you much more quickly. Please contact us at (615) 244-2825 or through www.bonitron.com

6. ENGINEERING DATA

6.1. RATINGS

See M3534 manual for ratings for ride-thru module.

6.2. WATT LOSS (INACTIVE POWER CONSUMPTION)

See M3534, KIT 3628T, and M3528 manuals for watt loss information.

6.3. RATING CHARTS

Fuses are installed by Bonitron on the M3534 ride-thru module. Fusing information is available in M3534 manual.

Table 6-1: Model Specifications

DC BUS CURRENT ①	M3534R CHASSIS SIZE	M3534B CHASSIS SIZE	RECOMMENDED FUSE RATING ②		SCCR RATING
			DC BUS (F1 F2)	AC LINE (F3 F4 F5)	
20 A	A5	-	20 A, 700 V	30 A, 600 V	100 kA ③
40 A	K7	K9	40 A, 700 V	40 A, 600 V	
85 A	A9	-	80 A, 700 V	100 A, 600 V	

① The input power source must be capable of handling a current surge of up to 200% of the M3534 nominal rating for the time specification of the M3534. Maximum duty cycle is 1% at full rated load.

② Fuses recommended for use with the M3534 are Gould-Shawmut A70QS series, Buss FWP series, or equivalent semiconductor fuses.

③ Suitable for use on a circuit capable of delivering not more than 100,000 rms symmetrical amperes with 10ms time constant, 700 volts maximum when protected by recommended fuses.

Table 6-2: Voltage Specifications Table

AC INPUT VOLTAGE	TOLERANCE	OUTPUT DC BUS NOMINAL VOLTAGE	THRESHOLD VOLTAGE	Low DC Bus VOLTAGE FAULT
230 VAC	± 10%	320 VDC	285 VDC (adjustable from 220-300)	250 VDC
380 VAC	± 10%	530 VDC	485 VDC (adjustable from 440-540)	450 VDC
400 VAC	± 10%	560 VDC	495 VDC (adjustable from 440-540)	460 VDC
415 VAC	± 10%	580 VDC	500 VDC (adjustable from 440-540)	465 VDC
460 VAC	± 10%	640 VDC	585 VDC (adjustable from 525-625)	550 VDC

Table 6-3: M3534 kW Ratings

DC Bus CURRENT (AMPS)	230VAC SYSTEM VOLTAGE	380-415VAC SYSTEM VOLTAGE	460VAC SYSTEM VOLTAGE
20 A	6 kW	10 kW	12 kW
40 A	12 kW	20 kW	24 kW
85 A	25 kW	43 kW	50 kW

Table 6-4: Factory Setpoints for DC Bus Threshold and Test Boost Voltages

SYSTEM VOLTAGE	DC BUS THRESHOLD	TEST BOOST (+ 17%)
230 VAC	285 VDC	333 VDC
380-415 VAC	485 VDC	567 VDC
460 VAC	585 VDC	684 VDC

6.4. DIMENSIONS AND MECHANICAL DRAWINGS

Figure 6-1: E70 Cabinet Dimensional Outline

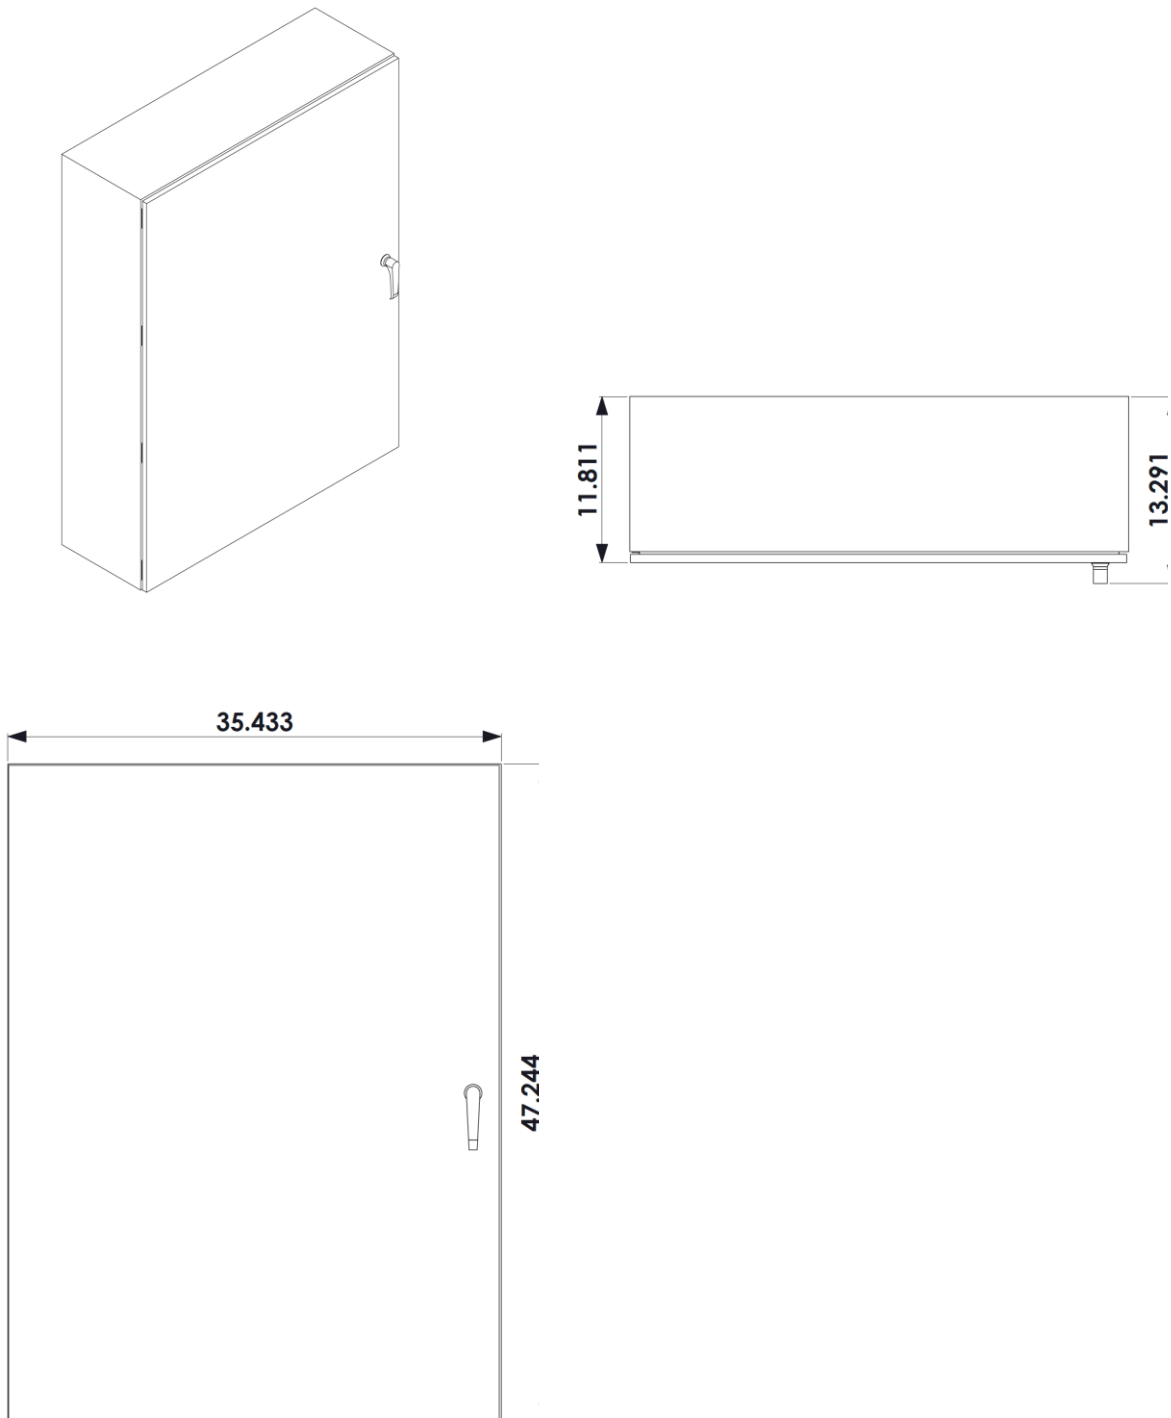


Figure 6-2: E71 Cabinet Dimensional Outline


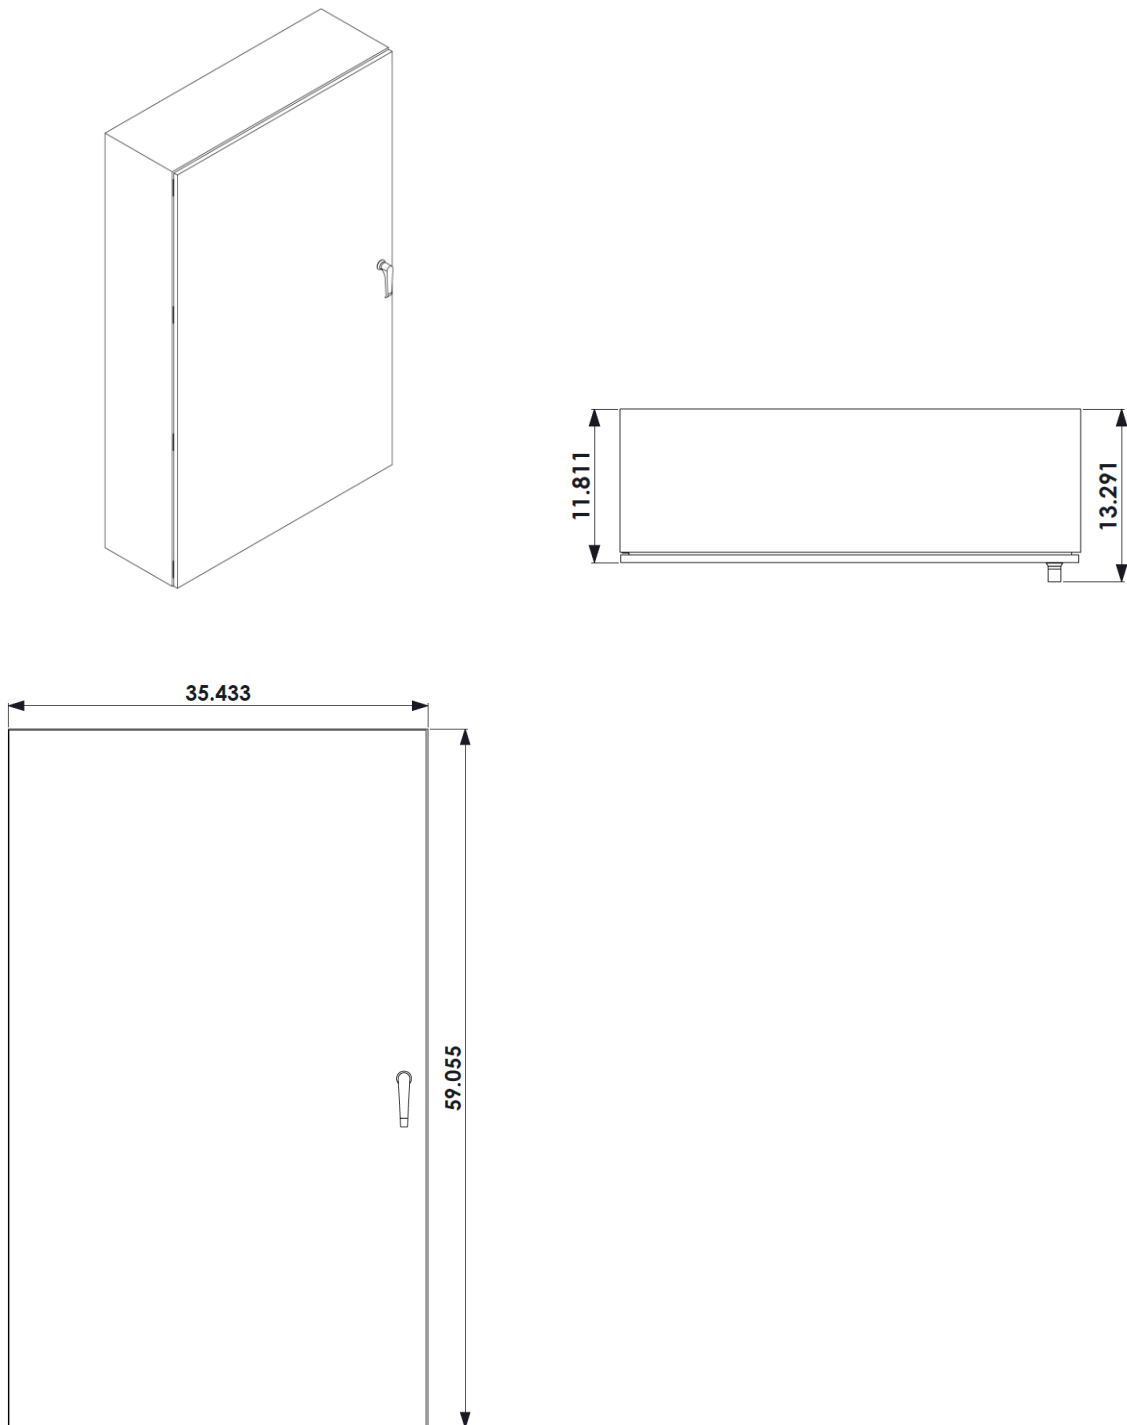


Figure 6-3: D80 Cabinet Dimensional Outline

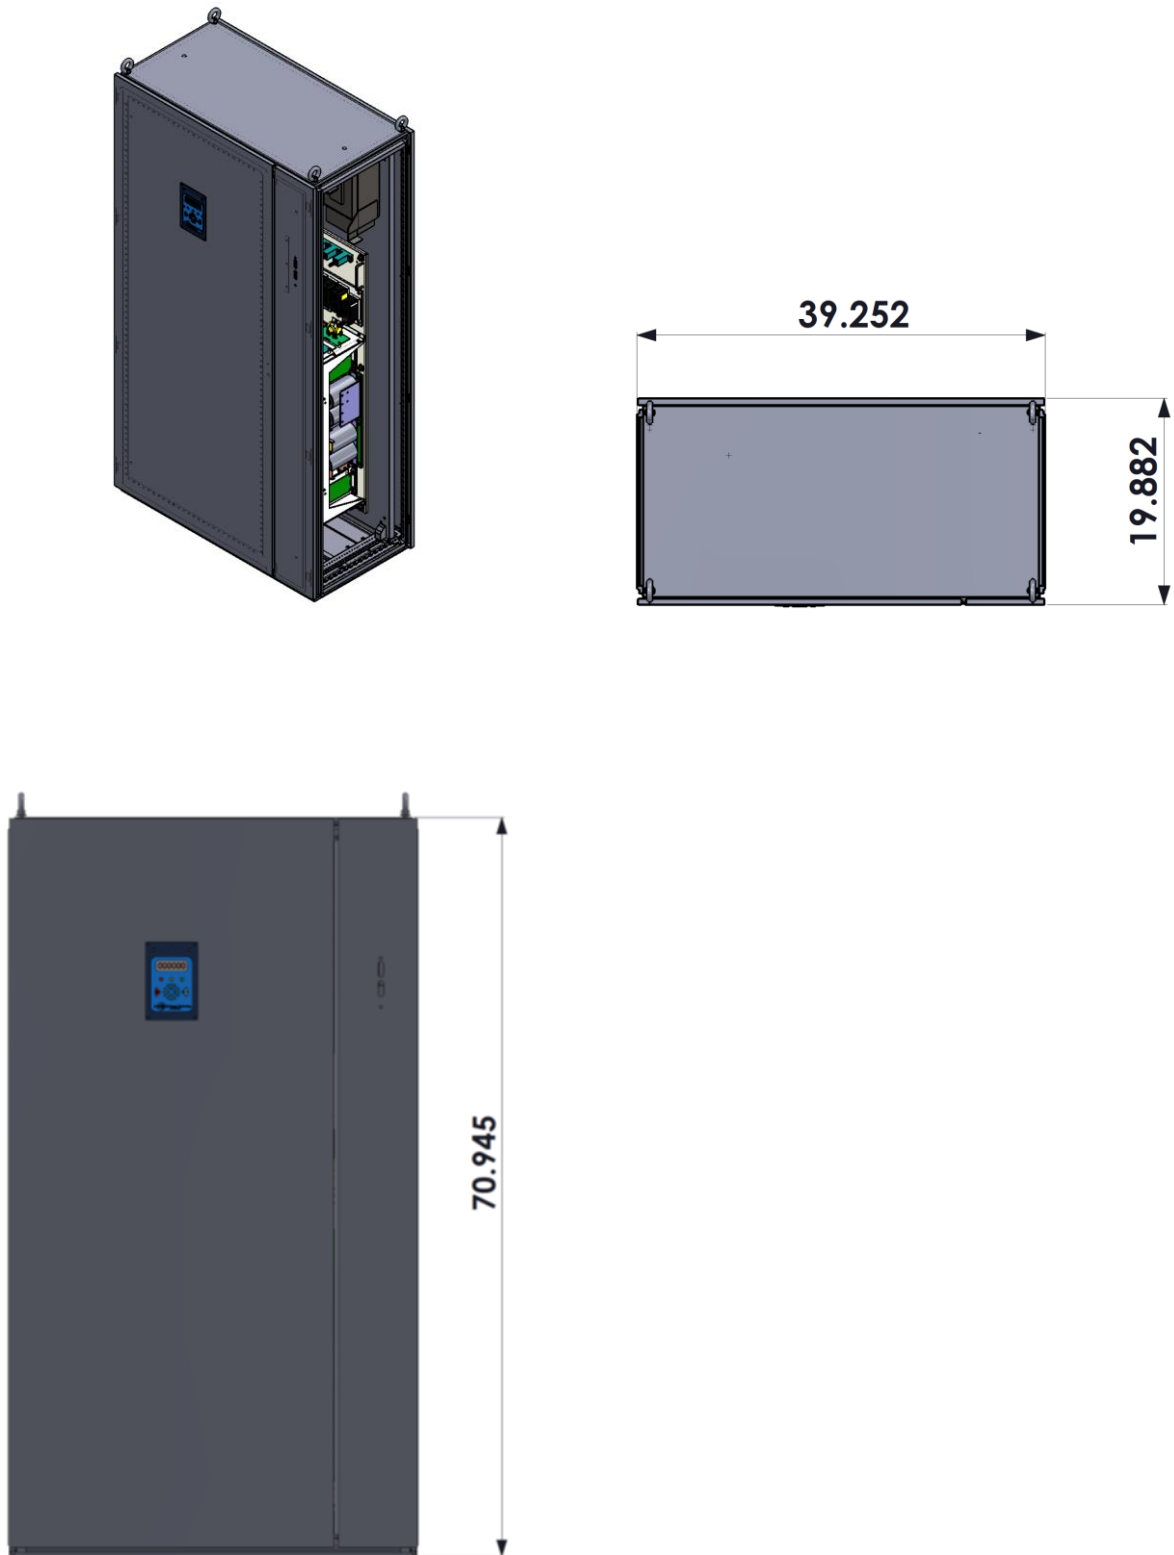

This image shows a full page of white paper with horizontal blue or grey ruling lines. The lines are evenly spaced and run across the width of the page, providing a template for handwriting practice or general writing. There are no margins, text, or other markings on the page.
